


# DRAWING CR-10

## CLEARANCE REQUIREMENTS FROM GAS METER

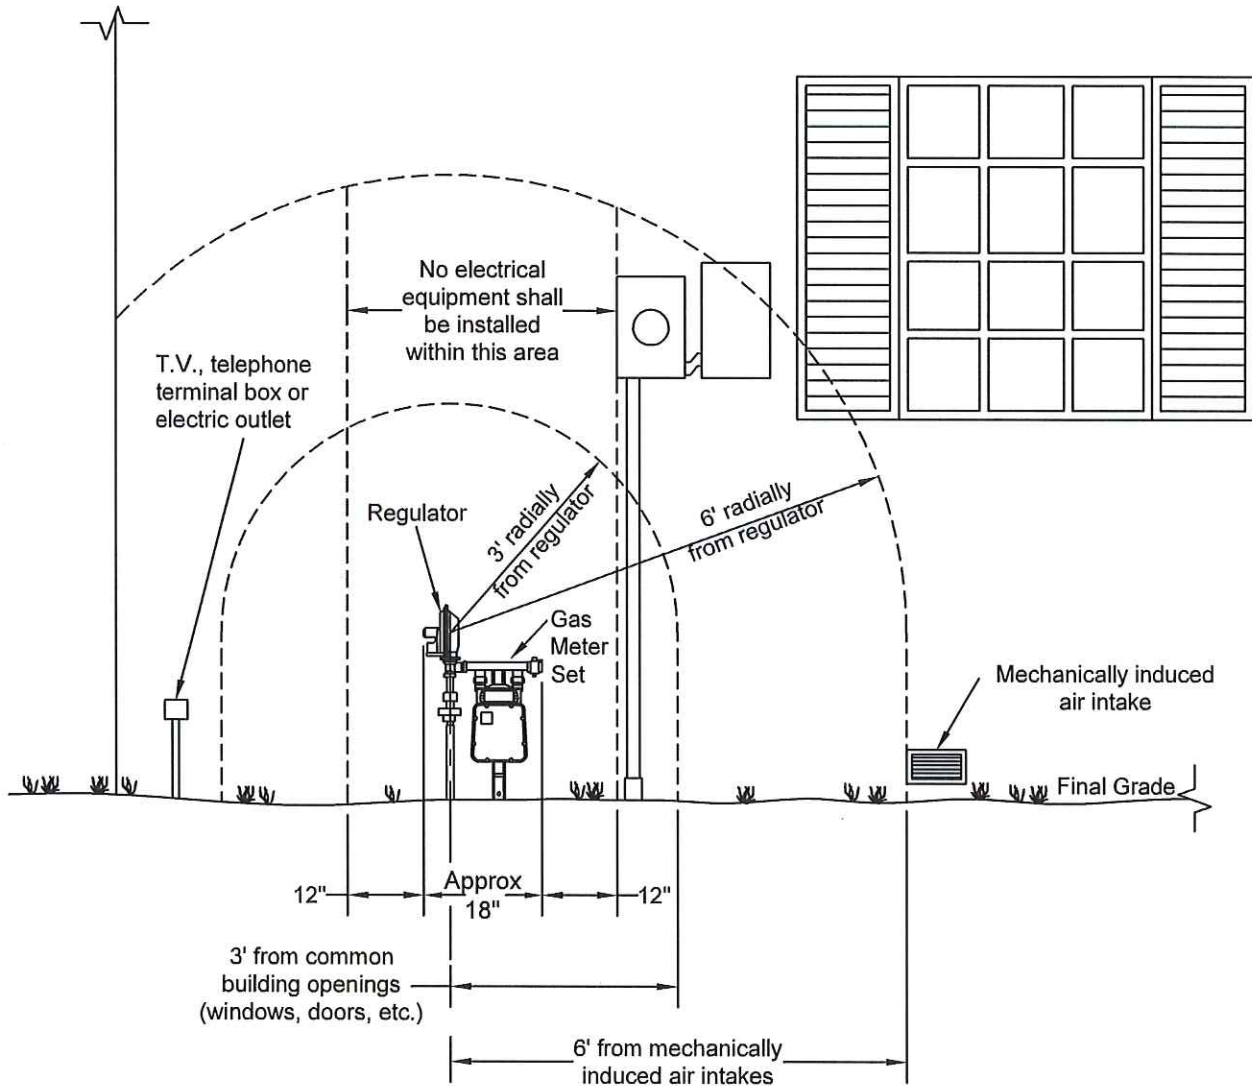

### NOTES:

1. 3' minimum working clearance from non-electrical obstructions is preferred around gas meter set.
2. Disregard clearances when measuring around corners of structure.
3. See drawings [SC-20](#) and [SC-20A](#) for ice and snow shield requirements.
4. Electric and plastic gas services within the same trench shall be separated by twelve (12) radial inches. Steel gas services shall not be installed in the same trench with an electric service and require a minimum of twelve (12) radial inches of separation.